



APLICAÇÃO

Luminária de sobrepor

ESTRUTURA

Luminária comercial de sobrepor, corpo em chapa de aço tratada e fosfatizada com pintura eletrostática em epóxi-pó na cor brando fosco, com refletância de 92%. – Grau de Proteção IP20.


SISTEMA ÓTICO

Refletor chapa de aço tratada e fosfatizada com pintura eletrostática em epóxi-pó na cor brando fosco, com refletância de 92%.

EQUIPAMENTOS ELÉTRICOS

Soquetes: Policarbonato com sistema de engate rápido para T8, com travamento anti-vibratório de segurança e contatos elétricos em bronze fosforoso

CURVA FOTOMÉTRICA

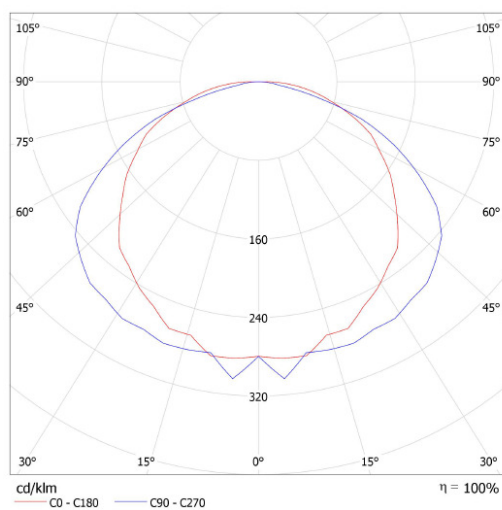

ÍNDICE DE OFUSCAMENTO UNIFICADO - UGR

Glare Evaluation According to UGR											
ρ Ceiling		70	70	50	30	70	70	50	50	30	
ρ Walls		50	30	50	30	30	50	30	50	30	
ρ Floor		20	20	20	20	20	20	20	20	20	
Room Size X Y	Viewing direction at right angles to lamp axis					Viewing direction parallel to lamp axis					
2H	2H	16.8	18.2	17.1	18.4	18.6	16.9	18.3	17.2	18.6	18.8
	3H	18.6	19.9	19.0	20.2	20.5	18.4	19.6	18.7	19.9	20.2
	4H	19.3	20.5	19.7	20.8	21.1	18.7	19.9	19.0	20.2	20.5
	6H	19.9	21.0	20.3	21.3	21.6	18.7	19.9	19.1	20.2	20.5
	8H	20.1	21.2	20.5	21.5	21.8	18.7	19.8	19.1	20.1	20.5
4H	12H	20.3	21.3	20.7	21.7	22.0	18.7	19.7	19.1	20.1	20.4
	2H	17.4	18.6	17.8	18.9	19.2	17.5	18.8	17.9	19.0	19.3
	3H	19.4	20.5	19.8	20.8	21.1	19.2	20.2	19.5	20.5	20.9
	4H	20.2	21.1	20.6	21.5	21.9	19.6	20.5	20.0	20.8	21.2
	6H	20.9	21.7	21.3	22.0	22.4	19.7	20.5	20.1	20.9	21.3
8H	8H	21.1	21.9	21.6	22.3	22.7	19.7	20.5	20.1	20.8	21.3
	12H	21.3	22.0	21.8	22.4	22.9	19.7	20.4	20.2	20.8	21.2
	4H	20.4	21.1	20.8	21.5	22.0	19.8	20.6	20.3	21.0	21.4
	6H	21.1	21.7	21.6	22.2	22.6	20.0	20.6	20.5	21.0	21.5
	8H	21.4	22.0	21.9	22.4	22.9	20.0	20.6	20.5	21.0	21.5
12H	12H	21.7	22.2	22.2	22.6	23.1	20.0	20.5	20.5	21.0	21.5
	4H	20.4	21.1	20.8	21.5	21.9	19.8	20.5	20.3	20.9	21.3
	6H	21.1	21.7	21.6	22.1	22.6	20.0	20.6	20.5	21.0	21.5
	8H	21.4	21.9	21.9	22.4	22.9	20.1	20.5	20.6	21.0	21.5
	8H	21.4	21.9	21.9	22.4	22.9	20.1	20.5	20.6	21.0	21.5


Variation of the observer position for the luminaire distances S		
S = 1.0H	+0.1 / -0.1	+0.1 / -0.1
S = 1.5H	+0.2 / -0.3	+0.3 / -0.5
S = 2.0H	+0.4 / -0.5	+0.7 / -1.0

Standard table	BK06	BK04
Correction Summand	0.3	-1.5

Corrected Glare Indices referring to 3330lm Total Luminous Flux

The UGR values have been calculated according to CIE Publ. 117 Spacing-to-Height-Ratio = 1.00.

DIAGRAMA DE CONE

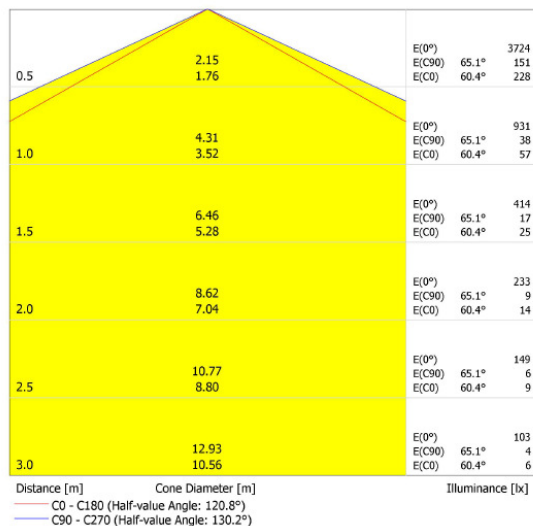

MODELO	INSTALAÇÃO	LÂMPADA	COMP.	LARGURA	ALTURA	NICHO
FIDL 2406 2XT18W	SOBREPOR	T8	1243 mm	120 mm	72 mm	