

APLICAÇÃO

Luminária de sobrepor

ESTRUTURA

Luminária comercial de sobrepor, corpo em chapa de aço tratada e fosfatizada com pintura eletrostática em epóxi-pó na cor brando fosco, com refletância de 92%. – Grau de Proteção IP20.


SISTEMA ÓTICO

Difusor translucido com 74% de refletância

EQUIPAMENTOS ELÉTRICOS

Equipada com soquetes E-27.

CURVA FOTOMÉTRICA

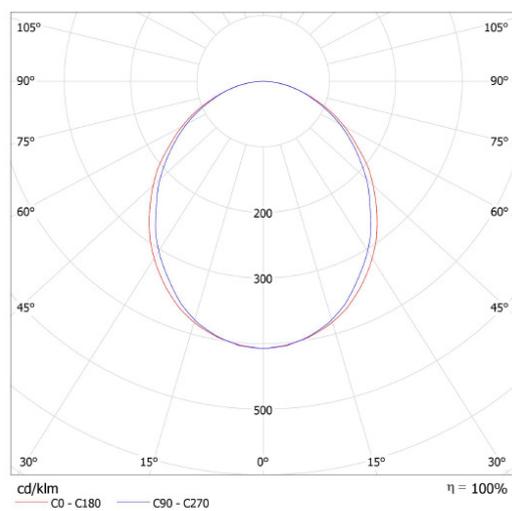


ÍNDICE DE OFUSCAMENTO UNIFICADO - UGR

Glare Evaluation According to UGR														
p Ceiling		70	70	50	50	30	70	70	50	50	30			
p Walls		50	30	50	30	30	50	30	50	30	30			
p Floor		20	20	20	20	20	20	20	20	20	20			
Room Size X	Room Size Y	Viewing direction at right angles to lamp axis					Viewing direction parallel to lamp axis							
2H	2H	18.5	19.7	18.8	20.0	20.2	18.2	19.5	18.5	19.7	19.9			
	3H	20.1	21.2	20.4	21.5	21.8	19.8	21.0	20.2	21.2	21.5			
	4H	20.7	21.8	21.0	22.0	22.3	20.5	21.5	20.8	21.8	22.1			
	6H	21.1	22.1	21.5	22.4	22.7	20.9	21.9	21.3	22.2	22.5			
	12H	21.4	22.3	21.7	22.6	22.9	21.1	22.0	21.4	22.3	22.7			
4H	2H	18.9	20.0	19.3	20.3	20.6	18.8	19.8	19.1	20.1	20.4			
	3H	20.8	21.7	21.2	22.0	22.4	20.6	21.5	21.0	21.9	22.2			
	4H	21.5	22.4	21.9	22.7	23.1	21.4	22.2	21.8	22.5	22.9			
	6H	22.1	22.8	22.6	23.2	23.6	22.0	22.7	22.4	23.1	23.4			
	8H	22.3	23.0	22.8	23.4	23.8	22.2	22.8	22.6	23.2	23.6			
8H	2H	22.5	23.1	22.9	23.5	23.9	22.3	22.9	22.7	23.3	23.7			
	4H	21.8	22.5	22.2	22.9	23.3	21.7	22.3	22.1	22.7	23.1			
	6H	22.5	23.1	23.0	23.5	24.0	22.4	22.9	22.8	23.4	23.8			
	8H	22.8	23.3	23.3	23.7	24.2	22.7	23.1	23.1	23.6	24.1			
	12H	23.0	23.4	23.5	23.9	24.4	22.9	23.3	23.4	23.7	24.2			
12H	4H	21.8	22.4	22.3	22.8	23.3	21.7	22.3	22.1	22.7	23.1			
	6H	22.6	23.1	23.1	23.5	24.0	22.5	22.9	22.9	23.4	23.8			
	8H	22.9	23.3	23.4	23.8	24.3	22.8	23.2	23.3	23.6	24.1			
Variation of the observer position for the luminaire distances S														
S = 1.0H		+0.1	-0.1		+0.1	-0.1								
S = 1.5H		+0.2	-0.4		+0.2	-0.4								
S = 2.0H		+0.4	-0.7		+0.4	-0.8								
Standard table Correction Summand		BK05			BK05									
		4.5			4.3									
Corrected Glare Indices referring to 1300lm Total Luminous Flux														

The UGR values have been calculated according to CIE Publ. 117 Spacing-to-Height-Ratio = 1.00.

DIAGRAMA DE CONE

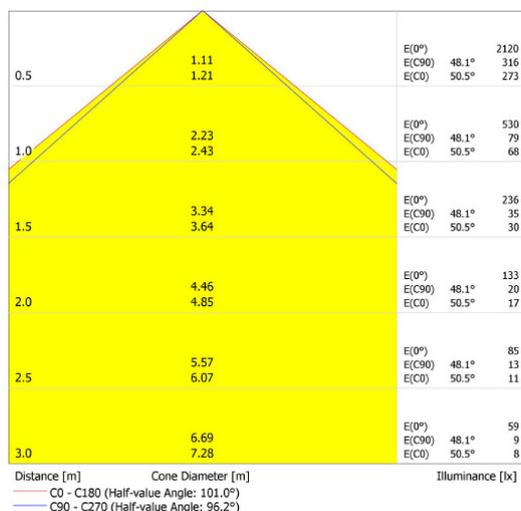

MODELO	INSTALAÇÃO	LÂMPADA	COMP.	LARGURA	ALTURA	NICHO
FSFS 2XB9W	SOBREPOR	E-27	250 mm	251 mm	91 mm	