



### APLICAÇÃO

Luminária de sobrepor.

### ESTRUTURA

Luminária comercial de sobrepor, corpo em chapa de aço tratada e fosfatizada com pintura eletrostática em epóxi-pó na cor branco fosco, com refletância de 92%. – Grau de Proteção IP54.






### SISTEMA ÓTICO

Difusor Translúcido com transmitância de 88%.


### EQUIPAMENTOS ELÉTRICOS

Equipada com módulos de LED com LM80, que possuem LM70 para TM-21, atendendo aos requisitos mínimos do DLC (Design Lighting Consortium) garantindo a LM-79 para a luminária. Com opções 220V, Bi-Volt e Dimerizável (0-10V).

### INFORMAÇÕES TÉCNICAS

<b>W</b>	52,7 W
	3000 / 4000 / 5000K
	>80
	220V
	5,126 lm
	5 ANOS

### CURVA FOTOMÉTRICA


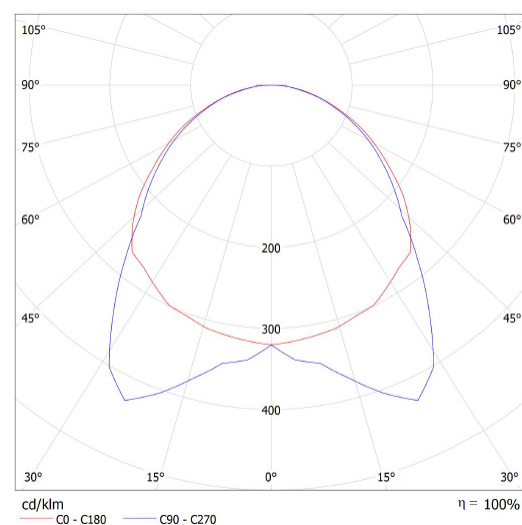


## ÍNDICE DE OFUSCAMENTO UNIFICADO - UGR

Glare Evaluation According to UGR													
p Ceiling		70	70	50	50	30	70	70	50	50	30	30	
p Walls		50	30	50	30	30	50	30	50	30	30	30	
p Floor		20	20	20	20	20	20	20	20	20	20	20	
Room Size X	Y	Viewing direction at right angles to lamp axis					Viewing direction parallel to lamp axis						
2H	2H	18.3	19.6	18.6	19.8	20.1	18.1	19.4	18.4	19.7	19.9		
	3H	19.8	21.0	20.1	21.2	21.5	19.6	20.7	19.9	21.0	21.3		
	4H	20.4	21.5	20.7	21.8	22.1	20.2	21.3	20.5	21.6	21.9		
	6H	20.9	21.9	21.2	22.2	22.5	20.6	21.7	21.0	22.0	22.3		
	8H	21.0	22.0	21.4	22.4	22.7	20.8	21.8	21.2	22.1	22.4		
4H	2H	18.9	20.0	19.2	20.3	20.6	18.8	19.9	19.1	20.2	20.5		
	3H	20.6	21.5	21.0	21.9	22.2	20.4	21.4	20.8	21.7	22.0		
	4H	21.3	22.2	21.7	22.5	22.9	21.2	22.0	21.6	22.4	22.7		
	6H	22.0	22.7	22.4	23.1	23.5	21.8	22.5	22.2	22.9	23.3		
	8H	22.2	22.9	22.6	23.3	23.7	22.0	22.7	22.4	23.1	23.5		
8H	2H	22.4	23.0	22.8	23.4	23.9	22.2	22.8	22.6	23.2	23.6		
	4H	21.6	22.3	22.1	22.7	23.1	21.5	22.2	21.9	22.6	23.0		
	6H	22.4	23.0	22.9	23.4	23.9	22.2	22.8	22.7	23.2	23.7		
	8H	22.8	23.2	23.2	23.7	24.2	22.5	23.0	23.0	23.5	24.0		
	12H	23.0	23.5	23.5	23.9	24.4	22.8	23.3	23.3	23.7	24.2		
12H	4H	21.7	22.3	22.1	22.7	23.1	21.5	22.1	22.0	22.5	23.0		
	6H	22.5	23.0	23.0	23.4	23.9	22.3	22.8	22.8	23.3	23.7		
	8H	22.9	23.3	23.4	23.8	24.3	22.7	23.1	23.2	23.6	24.1		
	Variation of the observer position for the luminaire distances S												
	S = 1.0H		+0.1	-0.1			+0.1	-0.1					
S = 1.5H		+0.2	-0.4			+0.2	-0.4						
S = 2.0H		+0.4	-0.7			+0.4	-0.7						
Standard table		BK06					BK06						
Correction Summand		5.6					5.4						
Corrected Glare Indices referring to 5126lm Total Luminous Flux													

The UGR values have been calculated according to CIE Publ. 117 Spacing-to-Height-Ratio = 0.25.

## DIAGRAMA DE CONE

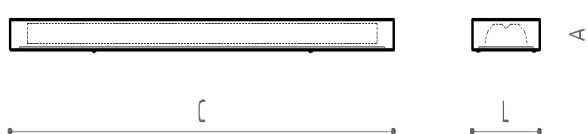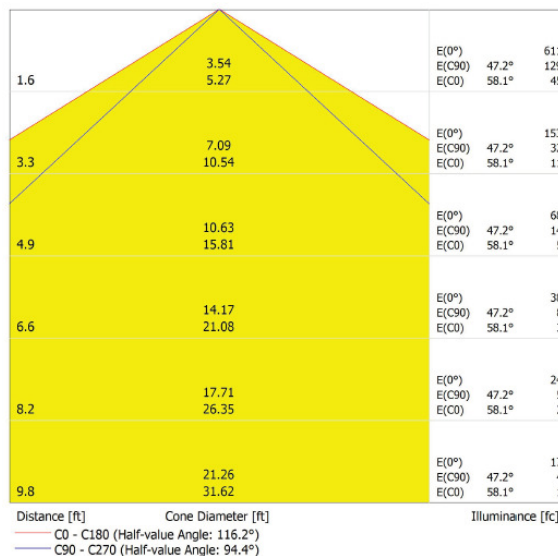

MODELO	INSTALAÇÃO	POTÊNCIA	TENSÃO	FLUXO LUM.	COMP.	LARGURA	ALTURA	NICHO
LT IPI 3354 232 17	SOBREPOR	18,4 W	220 V	1,922 Lm	1240 mm	247 mm	69 mm	
LT IPI 3354 232 B17	SOBREPOR	18,4 W	Bi-Volt	1,922 Lm	1240 mm	247 mm	69 mm	
LT IPI 3354 232 D17	SOBREPOR	18,4 W	220V (01-10 V)	1,922 Lm	1240 mm	247 mm	69 mm	
LT IPI 3354 232 34	SOBREPOR	36,9 W	220 V	3,844 Lm	1240 mm	247 mm	69 mm	
LT IPI 3354 232 B34	SOBREPOR	36,9 W	Bi-Volt	3,844 Lm	1240 mm	247 mm	69 mm	
LT IPI 3354 232 D34	SOBREPOR	36,9 W	220V (01-10 V)	3,844 Lm	1240 mm	247 mm	69 mm	
<b>LT IPI 3354 232 48</b>	<b>SOBREPOR</b>	<b>52,7 W</b>	<b>220 V</b>	<b>5,126 Lm</b>	<b>1240 mm</b>	<b>247 mm</b>	<b>69 mm</b>	
LT IPI 3354 232 D48	SOBREPOR	52,7 W	220V (01-10 V)	5,126 Lm	1240 mm	247 mm	69 mm	